


RISER TO BE A MAXIMUM 5 HORIZONTAL FEET FROM POINT WHERE PIPE ENTERS THE BUILDING.

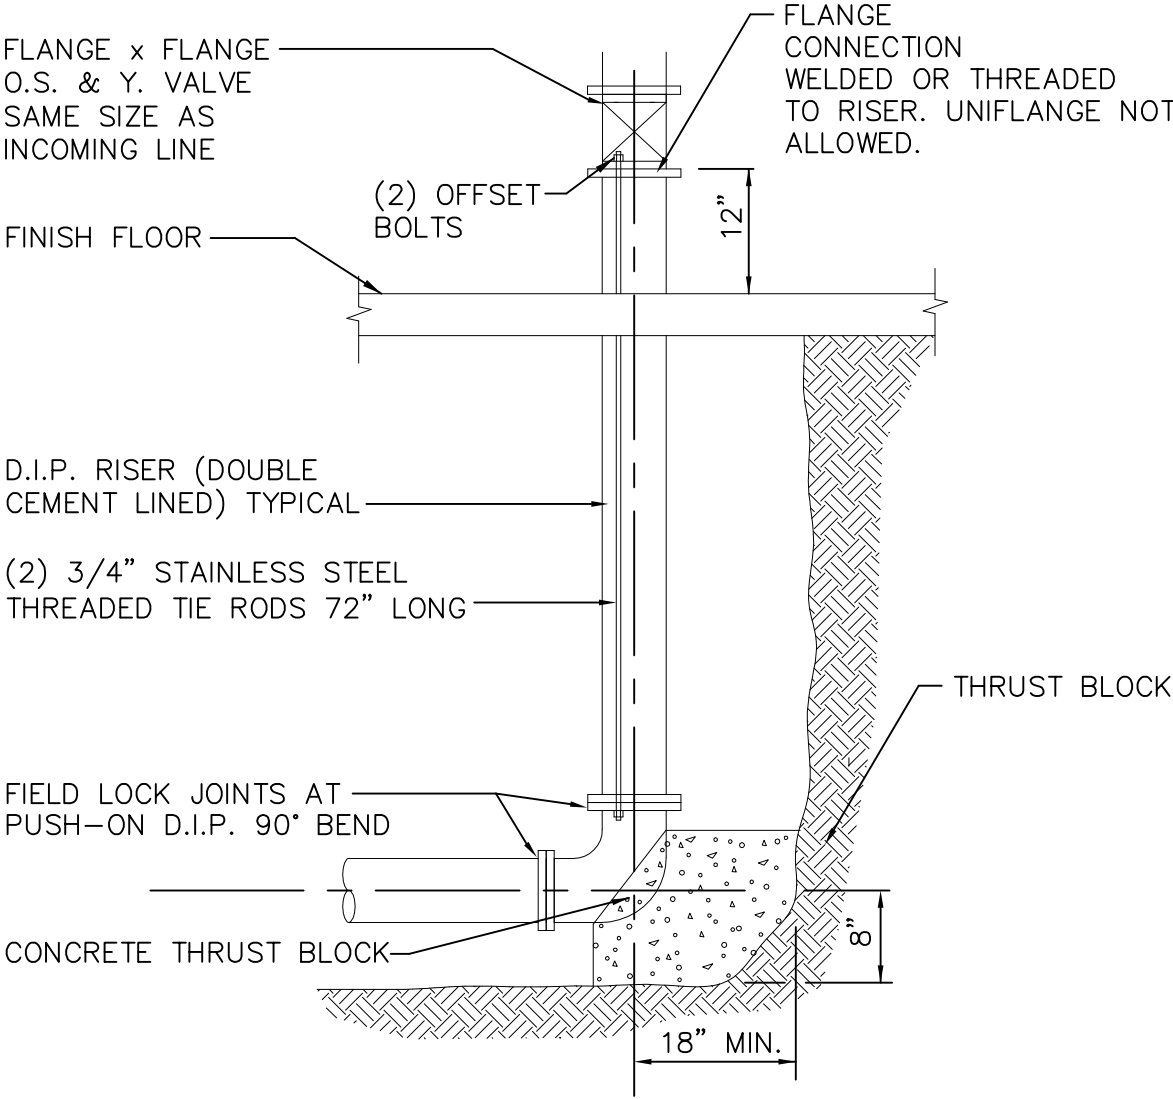

FIRE PROTECTION RISER DETAIL