NOTE:
PROVIDE ONE STORZ CONNECTION ON EACH HYDRANT ON THE LEFT NOZZLE WHEN FACING THE HYDRANT

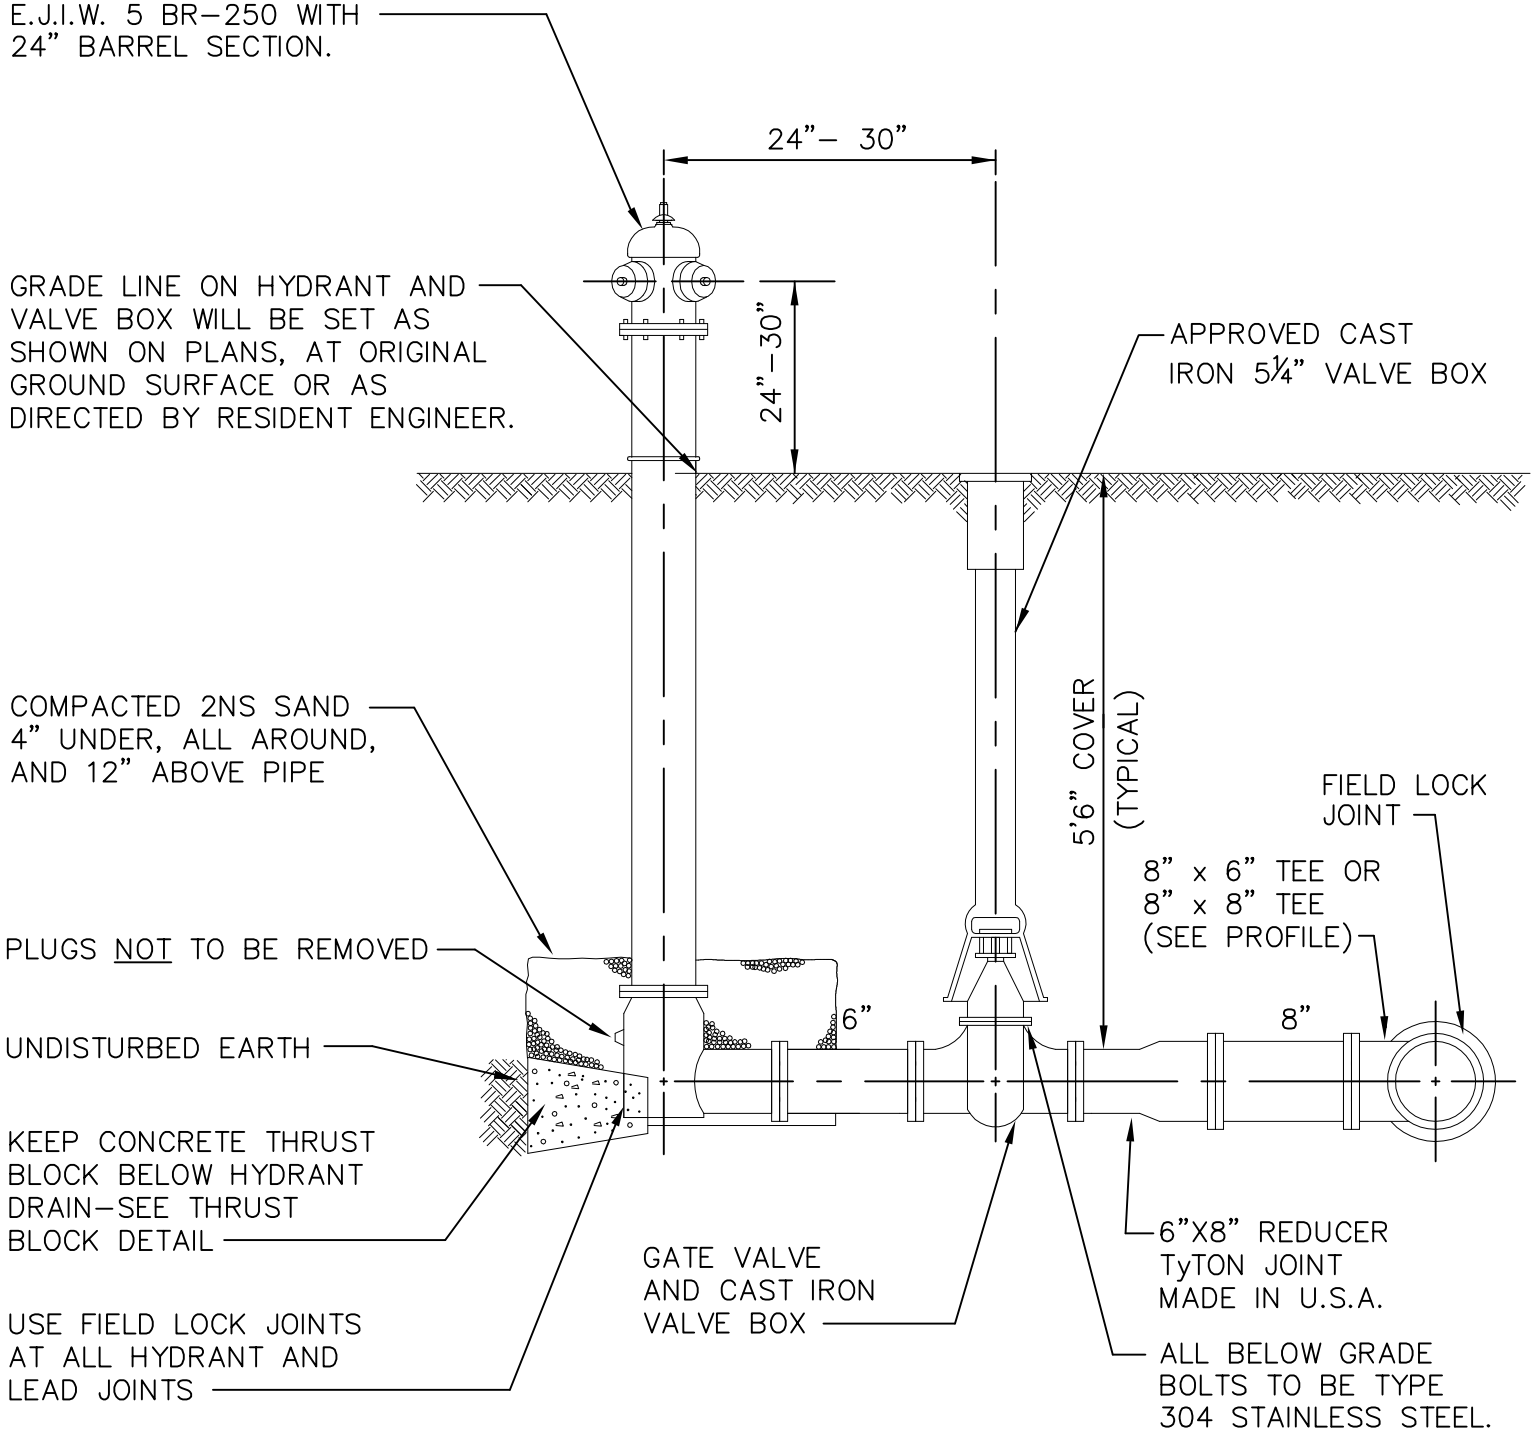

STANDARD FIRE HYDRANT